




UTILITY TRENCH BACKFILL AND RESURFACING STANDARD

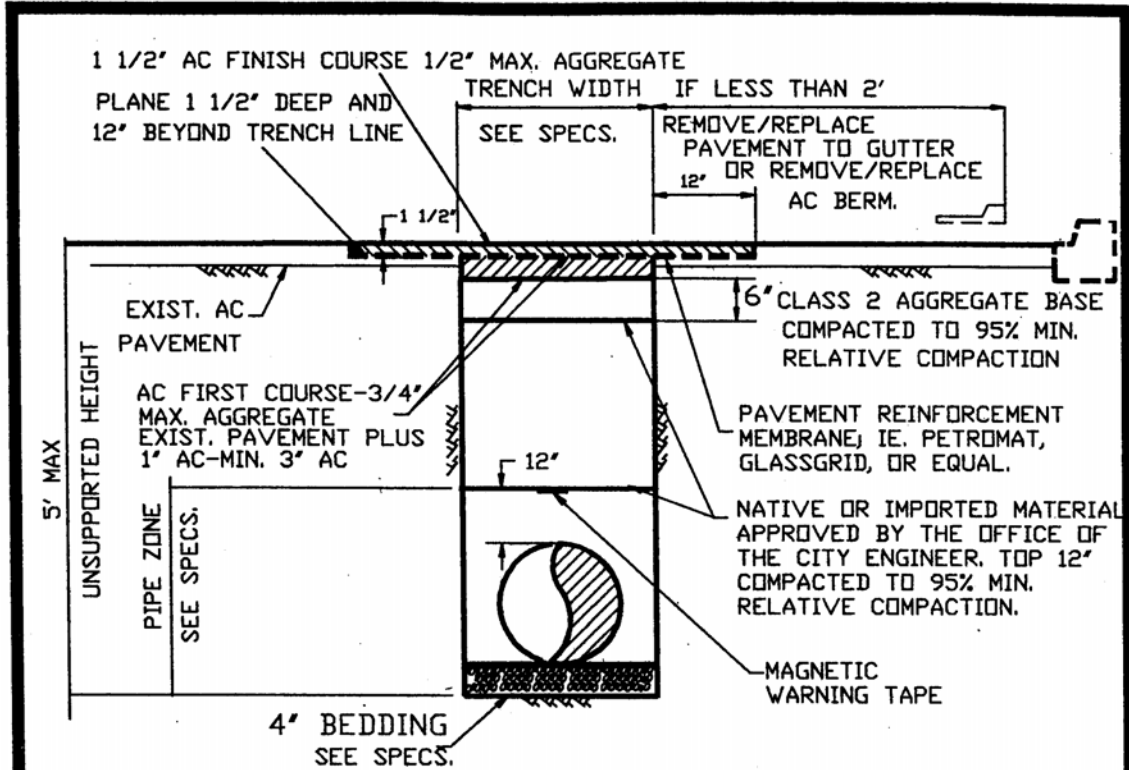

NOTES

1. FOR DEPTHS UP TO 5', NO TRENCH SUPPORT IS REQUIRED UNLESS WET, UNSTABLE OR RUNNING SOIL IS ENCOUNTERED. FOR DEPTHS EXCEEDING 5 FEET, SHORING OR SOLID SHEATHING IS REQUIRED. WHERE WET, UNSTABLE OR RUNNING SOIL IS ENCOUNTERED, SOLID SHEATHING IS REQUIRED.
2. EXISTING A.C. SHALL BE CUT AND REMOVED IN SUCH A MANNER SO AS NOT TO TEAR, BULGE OR DISPLACE ADJACENT PAVEMENT. EDGES SHALL BE CLEAN AND VERTICAL. ALL CUTS SHALL BE PARALLEL OR PERPENDICULAR TO STREET CENTERLINE, WHEN PRACTICAL.
3. FINISH COURSE OF AC RESURFACING SHALL BE LAID DOWN USING A SELF PROPELLED SPREADER BOX; UNLESS OTHERWISE APPROVED BY THE CITY ENGINEER.
4. CHIP OR SLURRY SEALING SHALL BE APPLIED AS REQUIRED BY AGENCY.

APPROVED BY THE CITY OF ENCINITAS CITY ENGINEER DATE 9-30-98	CITY OF ENCINITAS STANDARD DRAWING				REV	BY	APPR	DATE
	UTILITY TRENCH BACKFILL AND RESURFACING STANDARD							
DRAWING NUMBER								